

**Guide on energy savings
from ceiling-mounted heating
and cooling systems**

zehnder

Energy saving
more than
40%





Save energy using radiant heat. Energy is precious. As resources become more and more scarce, awareness of this important issue is growing. What is more, the magnitude of energy is also indicated by the constant, inexorable price rises.

Energy costs are also playing an ever-increasingly important role in trade and industry – ideas for lowering these fixed business costs are more in demand. Ceiling-mounted heating and cooling systems offer a practical and efficient solution.

Using the principle of radiant heat, radiant ceiling systems heat and cool buildings in a manner that is both cosy and efficient. They can be used in any room up to 30m high, from production halls, warehouses, schools, hospitals and offices to exhibition rooms and showrooms. Individually manufactured and tailored to the requirements of each property, ceiling-mounted heating and cooling systems can make a significant contribution to lowering a company's energy costs. This brochure tells you how.

Energy efficiency	4
Factors affecting energy efficiency	6
Sample calculation	12
Product overview	14

Energy efficiency

Whether for residential buildings, offices or business rooms or industrial or sports halls, the heat transfer system used influences not only the well-being of the space but also the freedom to design the space and its energy consumption; it is independent from heat generation and heat distribution. On the one hand, the task of heating surfaces is to distribute the heat generated as quickly and evenly as possible throughout the room, and on the other hand the heating and cooling system must be able to react quickly to changes in the load of heating and cooling required.


Energy saving potential

The heat transfer system used largely determines the benefit that will be gained from it. That is, heat should where possible be transferred in such a way that it can be used in the right place at exactly the right time. In other words:


The main energy saving potential when heating and cooling a building lies in making the correct choice of heat transfer system.

Factors affecting the energy efficiency of a heat transfer system


The heat transfer system essentially determines the comfort level and energy savings in a building. How and in what manner energy savings of over 40 % can be achieved is set out over the following pages.

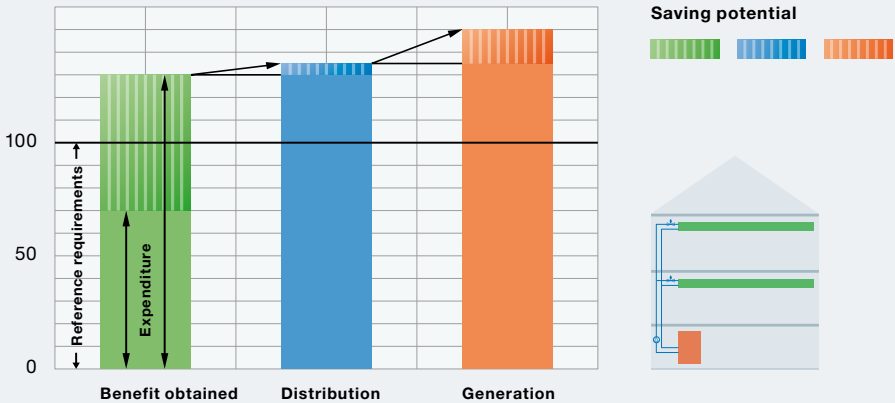

Expenditure and saving potential in terms of benefit obtained, distribution and generation for a building
 Source: Prof. a. D. Dr.-Ing. Heinz Bach

1 


Human temperature perception

2 

Heat distribution up to ceiling height

3 

Reaction time and controllability

4 


System temperatures

1

Human temperature perception

Human perception of temperature is the arithmetic mean of the indoor air temperature and the surface temperature, e.g. of the walls, ceiling and floor.

Due to the radiation and hence the higher surface temperature of ceiling-mounted cooling and heating systems, the indoor air temperature during heating can therefore be kept lower, can be higher during cooling, and still be perceived as pleasant. Energy costs are reduced, both when heating and when cooling, due to the lower or higher air temperature.

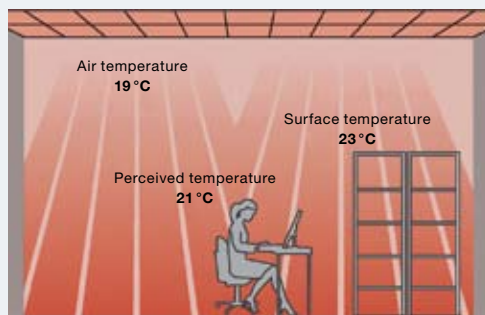

Thanks to the higher surface temperature, a much lower air temperature is sufficient for a ceiling-mounted radiant heating system in order to give people a sense of comfortable warmth.



2

Heat distribution up to ceiling height

Whereas, with air heating systems the heated air rises, radiant ceiling panels generate heat where the heat radiation comes into contact with objects (walls, floors and people). This results in an even temperature distribution throughout the entire room at ceiling level, and thus a considerably lower energy consumption.



Although the perceived temperature remains the same, the actual indoor air temperature can be up to 3K lower (for heating) or higher (for cooling). The consequential smaller difference between indoor air temperature and outdoor temperature means that heat loss is dramatically reduced.

With radiant ceiling panels

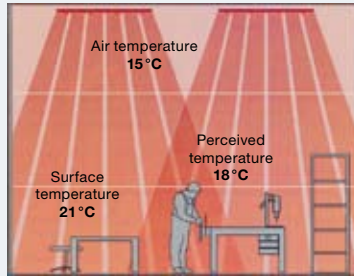


Temperature profile
Radiant ceiling panels

With air heating systems

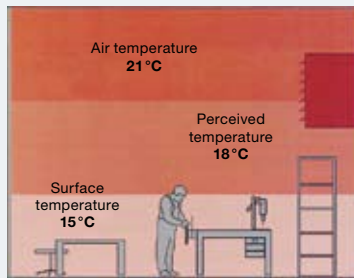

Temperature profile
Air heating system



Energy saving
potential

3

Reaction time and controllability

Buildings are becoming increasingly well insulated and thus need less and less energy. Even small variations in the heat load can result in major temperature fluctuations. The result is that users manually intervene in the system and remove the excess heat from the room, e.g. via ventilation.


The conclusion from this is that systems are required that can react quickly to changes in the heat load or temperature fluctuations in a room – systems with a rapid reaction time and a very good controllability.

Test series

To simulate the miscellaneous inertias of various systems, tests were carried out using a radiant ceiling panel, an underfloor heating system and an active building system. All systems were cooled to a surface temperature of 17 °C. The systems were then subjected to the same mass flow and the same flow temperature until each system had achieved a surface temperature of approx. 35 °C.



Example: A conference room is heated to 20 °C in the winter. The participants enter the room and give off body heat. This, plus additional heat loads from lighting, projectors, computers etc., makes the temperature of the room rise. The result is that in order to quickly bring the sharply increased room temperature back down to the desired 20 °C, the windows are opened – and precious energy is wasted.

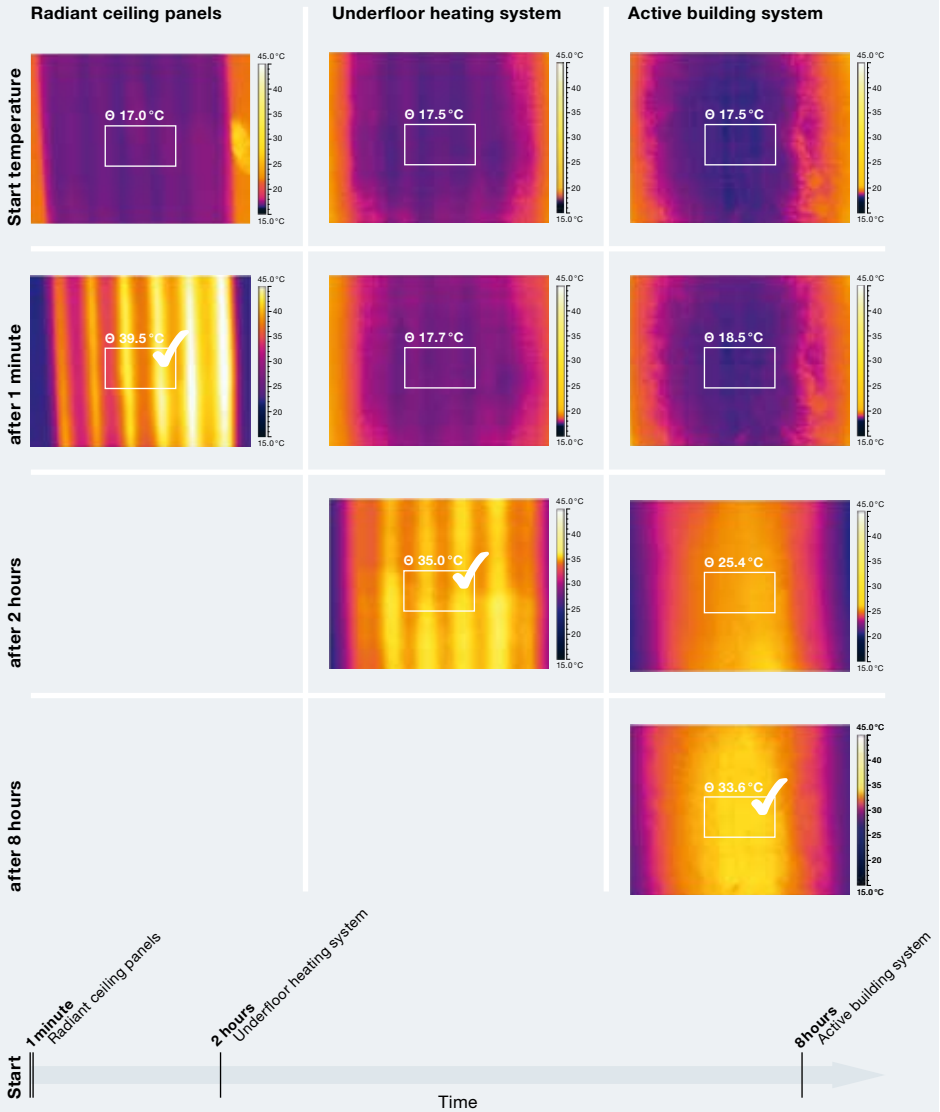

Result: the radiant ceiling panel achieved the desired surface temperature within only 1 minute, and thus displayed the fastest reaction time and capacity for self-regulation to cope with temperature fluctuations.

4


System temperatures

The future of heating is in the low-temperature field. These systems use less energy, and the energy that they do use is used very efficiently.

Heat transfer systems that work using radiant heat and have a low storage mass are ideally suited to low-temperature systems. Zehnder ceiling-mounted heating and cooling systems are a perfect example of this.

Requiring very low flow temperatures is important, especially when pumping heat. For example, if you use a heat transfer system that runs at a flow temperature of 50 °C, you will use around 90 % more energy than with a system that runs at a flow temperature of 30 °C.

	COP _{real}	Energy expenditure
Probe 5 °C/Heating 30 °C	6.4	100 %
Probe 5 °C/Heating 40 °C	4.5	140 %
Probe 5 °C/Heating 50 °C	3.4	190 %

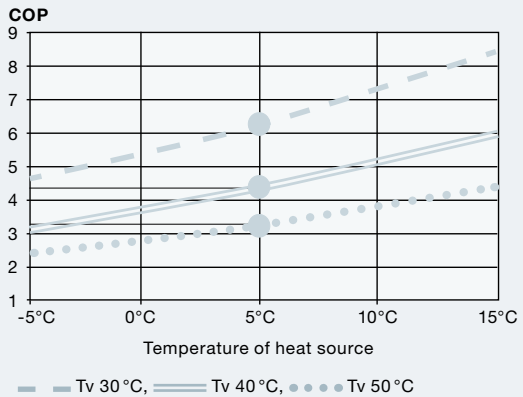

COP = Coefficient Of Performance

The COP indicates the relationship between the heat output (kW) generated by the heating network and the recorded electrical output of the heat pump (kW).

1



Human
temperature
perception

2



Heat distribution
up to ceiling
height

3



Reaction time
and
controllability

4



System
temperatures



with Zehnder ceiling-mounted heating and cooling systems

Sample calculations

The energy saving potential of over 40 % can be demonstrated and determined more precisely in accordance with DIN V 18599.

As an example we will use a comparison between radiant ceiling panels and air heaters.

Boundary conditions

Hall height 20 m, room temperature regulation for both systems via PI regulators, air distribution at a normal induction ratio, lateral air outlet

	f_{hydr}	f_{int}	$f_{Radiant}$	η_L	η_C	η_B
Zehnder ZBN	1,00	1,00	0,85	0,89	0,97	1,00
Air heating system	1,00	1,00	1,00	0,63	0,97	1,00

Basic information

Calculation formula under DIN V 18599

$$\eta_{h,ce} = \frac{1}{4 - (\eta_L + \eta_C + \eta_B)} \quad Q_{h,ce,mth} = \left[\frac{f_{Radiant} \cdot f_{int} \cdot f_{hydr}}{\eta_{h,ce}} - 1 \right] Q_{h,mth}$$

$Q_{h,ce,mth}$ additional monthly expenditure of heat transfer, in kWh/mth

$Q_{h,mth}$ monthly heat required, in kWh/mth

f_{hydr} hydraulic balancing factor

f_{int} intermittent operation factor


$f_{Radiant}$ factor for effect of radiance

$\eta_{h,ce}$ overall efficiency of heat transfer in room

η_L partial efficiency for vertical air temperature profile

η_C partial efficiency for room temperature regulation

η_B partial efficiency for specific losses from external structures

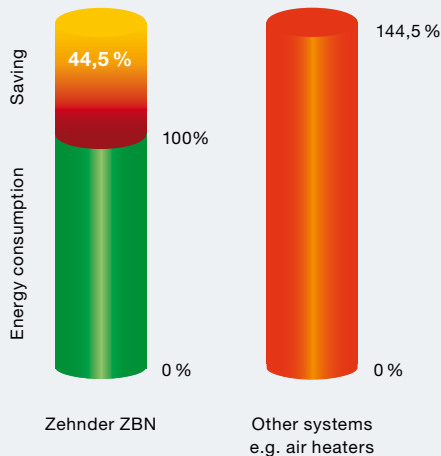

Energy consumption with radiant ceiling panels

$$\eta_{h,ce} = \frac{1}{4 - (\eta_L + \eta_C + \eta_B)} \quad Q_{h,ce,mth} = \left[\frac{f_{\text{Radiant}} \cdot f_{\text{int}} \cdot f_{\text{hydr}}}{\eta_{h,ce}} - 1 \right] Q_{h,mth}$$

$$\eta_{h,ce} = \frac{1}{4 - (0,89 + 0,97 + 1)} = 0,877$$

$$Q_{h,ce,mth} = \left[\frac{1 \cdot 1 \cdot 0,85}{0,877} - 1 \right] Q_{h,mth} = -0,031 Q_{h,mth}$$

$$Q_{h,ce,mth} = -0,031 Q_{h,mth} = -0,031 \cdot 10000 = \underline{-310 \text{ kWh}}$$

$$10000 \text{ kWh} - 310 \text{ kWh} = \underline{9690 \text{ kWh}} \rightarrow \mathbf{100 \%}$$

Energy consumption with air heaters

$$\eta_{h,ce} = \frac{1}{4 - (\eta_L + \eta_C + \eta_B)} \quad Q_{h,ce,mth} = \left[\frac{f_{\text{Radiant}} \cdot f_{\text{int}} \cdot f_{\text{hydr}}}{\eta_{h,ce}} - 1 \right] Q_{h,mth}$$

$$\eta_{h,ce} = \frac{1}{4 - (0,63 + 0,97 + 1)} = 0,714$$

$$Q_{h,ce,mth} = \left[\frac{1 \cdot 1 \cdot 1}{0,714} - 1 \right] Q_{h,mth} = 0,4 Q_{h,mth}$$

$$Q_{h,ce,mth} = 0,4 Q_{h,mth} = 0,4 \cdot 10000 = \underline{4000 \text{ kWh}}$$

$$10000 \text{ kWh} + 4000 \text{ kWh} = \underline{14000 \text{ kWh}} \quad \frac{14000 \cdot 100 \%}{9690} = \mathbf{144,5 \%}$$

Result

Energy saving with Zehnder
radiant ceiling panels 44.5 %



Products

Zehnder radiant ceiling panel systems can be used in practically all larger rooms of heights up to 30 m. Thanks to their rapid reaction time and their optimal heat distribution, they operate exceptionally efficiently.

zehnder *zbn*

- Blends in with the architecture – available in a range of colours
- Optimal heat distribution tailored to the room geometry – 7 standard widths and special widths available
- Wide range of special solutions: angled panels, perforated panels for sound absorption, panels with holes for light fittings, ball deflector grids, raised top pieces, etc.
- Longer individual components (up to 7.5 m) mean up to 20 % lower installation costs



zehnder *zip*

- Special solutions: Ball deflector grids for sports halls
- Particularly easy to install owing to its light weight, which makes it perfect for refurbishment
- Simple to install – the modules attach via a press/screw fitting
- Easy to store and quick to deliver thanks to its standardised components
- Corrosion protection: special finishes available for damp rooms



zehnder *carboline*

- Optimal controllability, short reaction time
- Flush appearance – blends in aesthetically with architecture
- Easy to fit to both new and existing grid and suspended ceilings
- Perforated finish provides noise insulation
- Long lifespan thanks to corrosion-resistant materials
- Antibacterial



zehnder *como*

- Available in a range of colours
- Range of models: grids, sails, covered ceilings, invisible under plasterboard – fits the architecture
- Special solutions such as cut-outs for light fittings or projectors
- Noise absorption through perforated surface
- Long lifespan thanks to corrosion-resistant materials



Zehnder GmbH · Europastraße 14 · 77933 Lahr · Germany
Tel. +49 78 21/586-0 · Fax +49 78 21/586-403
info@zehnder-online.de · www.zehnder-online.de

zehnder